



Site Report

T00001 Mirkwood Industrial

From 18 January 2021 to 24 January 2021

Connection Quality

Number of daily connections with the site. More connections in a day means less connection loss with the site. A few factors that contribute to connection loss include: theft, power loss and weak GSM signal.

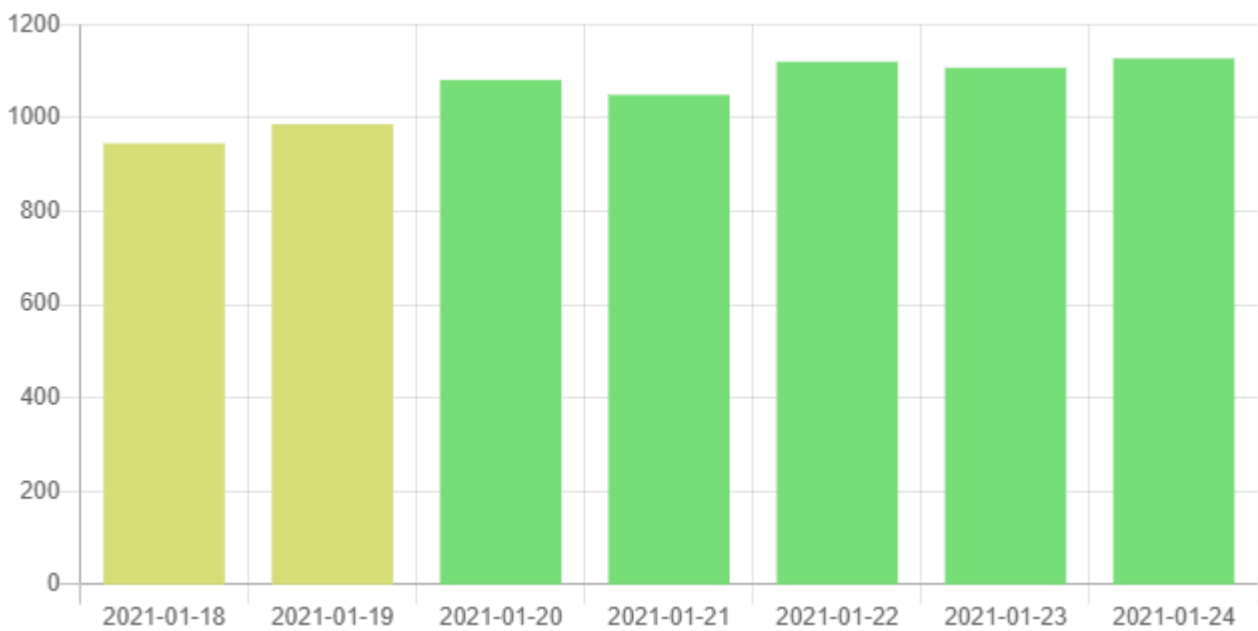

Meters installed on site:


T00001 Mirkwood Industrial Landlord
T00001 Mirkwood Industrial Tenant 1
T00001 Mirkwood Industrial Tenant 2

Meter: T00001 Mirkwood Industrial LL

Lowest Voltage 48.6V	Highest Voltage 246.66V	Below 220V 4.76% (36)	Above 240V 21% (159)
-------------------------	----------------------------	--------------------------	-------------------------

Voltage Distribution

The number of voltage readings in each voltage range.

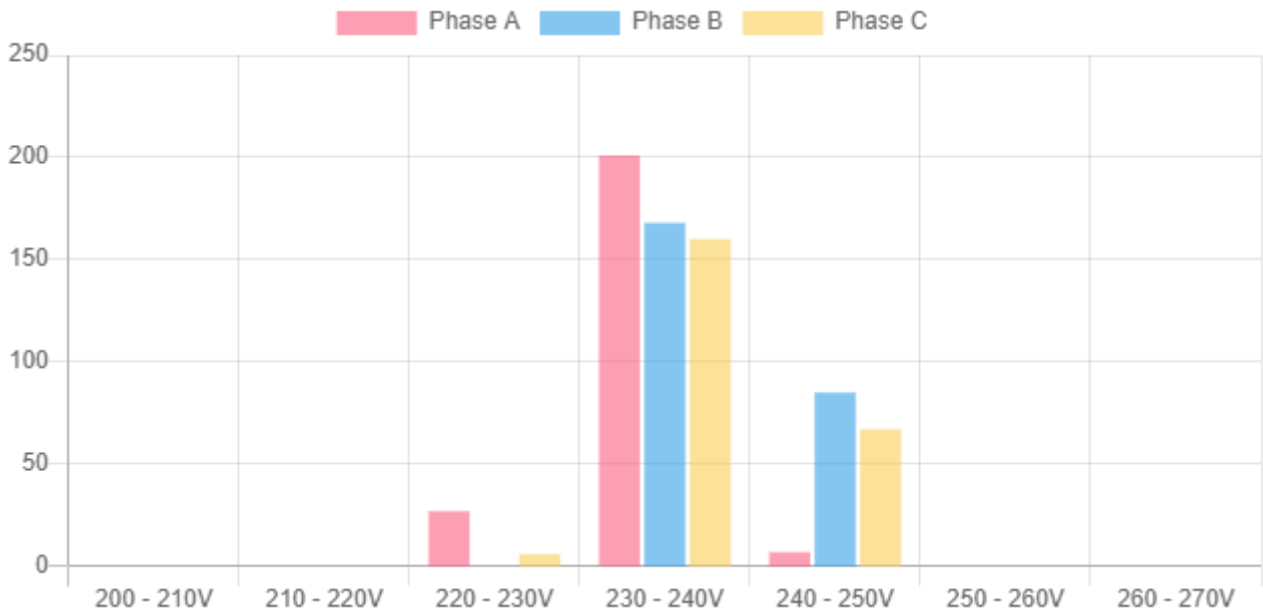

Meter: T00001 Mirkwood Industrial Tenant1

No voltage data available or voltages are not being measured for this meter. Try the main's meter instead.